


InoculateIT 4.53 for NT


How to verify InoculateIT 4.53 is updating virus definitions on workstations

Disclaimer: Maple Tronics computers, Inc. has taken reasonable effort to ensure that the material contained in this document is correct and accurate, however, Maple Tronics Computers, Inc. gives no warranty and accepts no responsibility for the accuracy or completeness of the material. Maple Tronics Computers, Inc. gives no warranty or guarantee that the use of the most current version of InoculateIT will protect workstations from receiving a virus, nor does Maple Tronics Computers, Inc. accept the responsibility if a virus should be acquired while using any version of InoculateIT.


1. Go to Computer Associates <http://support.ca.com/Download/virussig.html#inocnt> and note the signature version for Inoculan 4.0 / InoculateIT 4.5x for Windows NT/2000 and <http://support.ca.com/Download/virussig.html#ilavwin95a> and note the signature version for Inoculan 4.0 / InoculateIT 4.5x Clients for Windows 95.
2. On the Server that handles virus signature distribution. Select Start → Programs → InoculateIT for NT → InoculateIT for Windows NT.
3. Select Domain Manager.

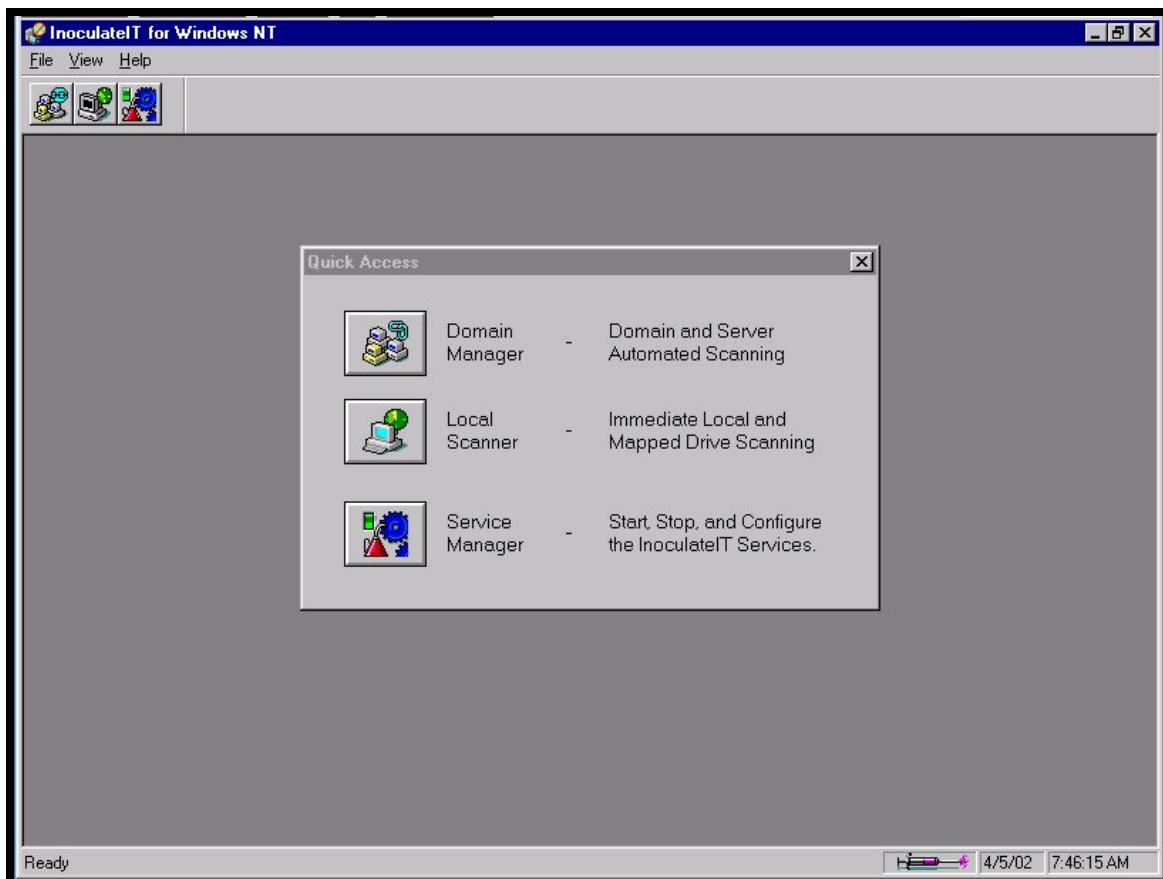

4. Under Microsoft Networks highlight the server and compare the virus signature version to the version on Computer Associates web site.

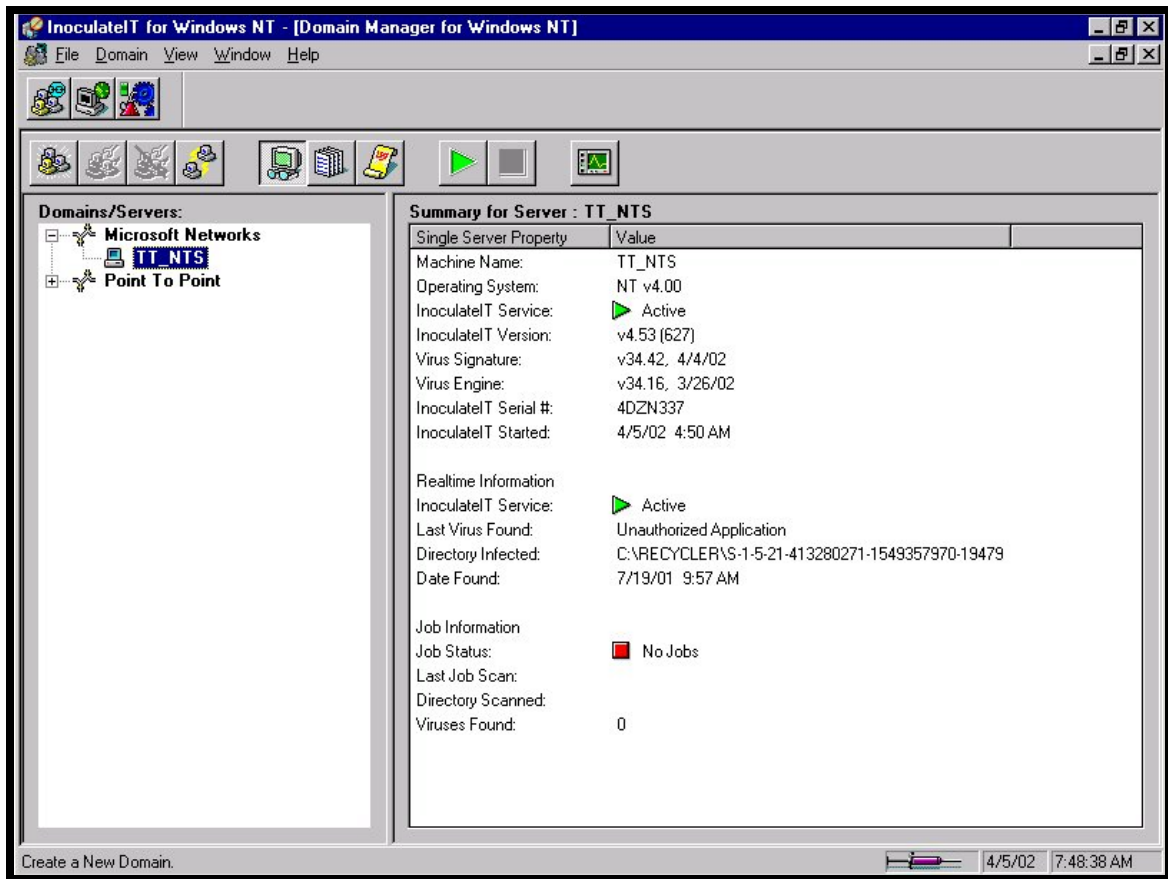

5. On the workstations right-click on the InoculateIT Realtime icon in the system tray and select options.

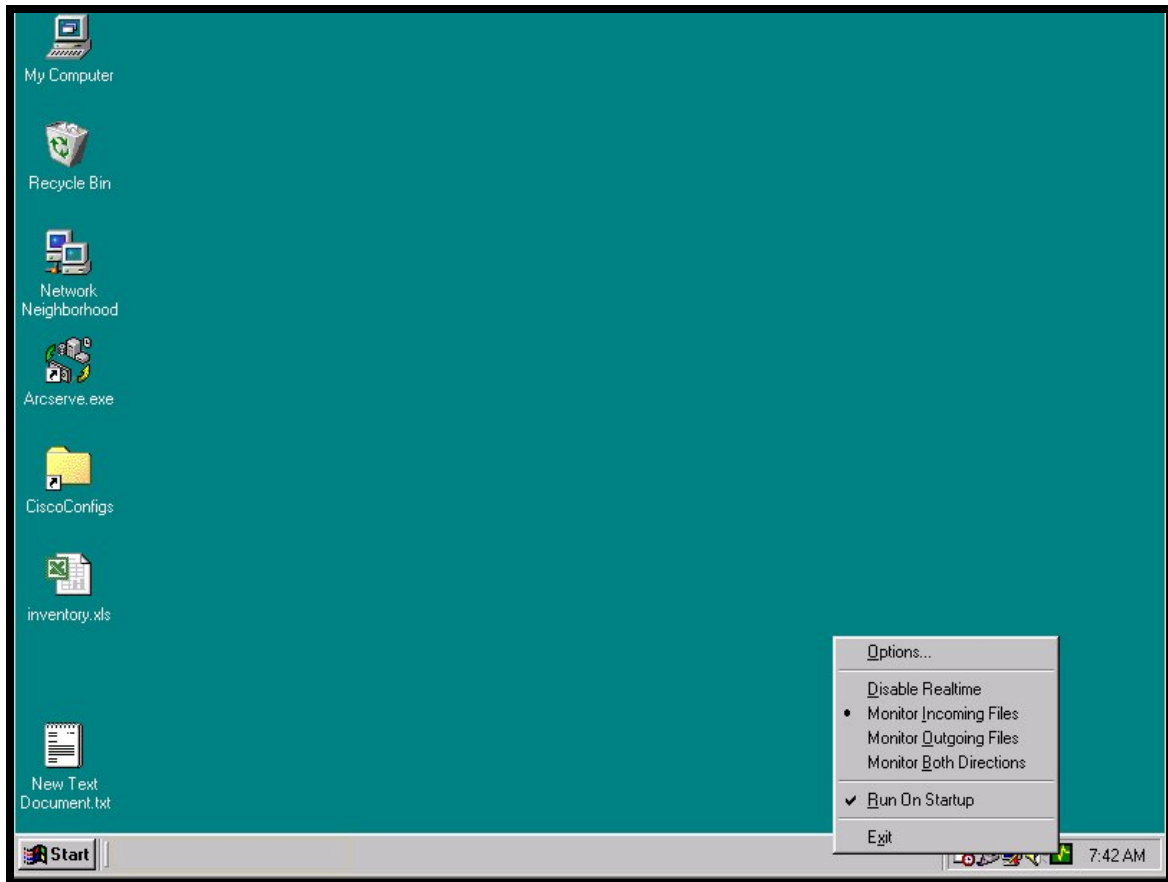

6. Click on the Version tab and verify the workstation signature version is the same as what's listed on Computer Associates Web site.

